



Dual Output Sounder Control Module with PSU Fault input and Isolator

EV-SCM2

Part no. F16-82270

General Description

EV-SCM2 is a Dual Output Sounder Control Module, with PSU Fault Input and integral –ve line Short circuit isolator compatible with Evolution analogue addressable system devices.

The Module includes a setting option to improve synchronisation of Sounder / Beacon products.

LEDs are provided to Indicate Output active, Fault and Isolator Open.

The module is designed to fit the range of standard UK 2-Gang electrical enclosures, including Surface & Flush mount options.

Device address may be set using EV-AD2-EXT Hand held programmer.

The Short Circuit Isolator will protect the system, whilst allowing the device to continue communication from the opposite side. The isolator will self-reset when the fault clears.

The following resistors are required for Fault and Alarm monitoring:

- EOL = 10k Ohm

Approvals

Test Standards	EN54-17: 2005 / AC: 2007 EN54-18: 2005 / AC: 2007
CPR Certificate	0905-CPR-00641
UKCA Certificate	0359-UKCA-CPR-00010
DoP Number	00641

Notes

Not compatible with Advanced MxPro4 (Mx4000) Panel. Please use Non-SCI model.

It is not possible to mix +ve and -ve isolator styles on a system.

Data

Operating loop voltage	20 to 38 Vdc
Quiescent current	740 μ A
Alarm current	3.1 mA
Current in short circuit	15 mA
External power supply required	20 to 30 Vdc
PSU fault input	1 x Input
Output relay contact rating	2 x 1 Amps @ 30 Vdc
Operating temperature	-10°C to +55°C
Storage temperature	-40°C to +80°C
Relative humidity	< RH 95% (Non-condensing)
Cable terminals	0.75 to 2.5 mm ²
Material	PC/ABS
Weight	145 g


Short Circuit Isolator

Minimum sw open voltage (V _{so min})	11 Vdc
Maximum sw open voltage (V _{so max})	14 Vdc
Minimum sw close voltage (V _{sc min})	3 Vdc
Maximum sw close voltage (V _{sc max})	10 Vdc
Maximum line current (I _{c max})	500 mA
Maximum switching current (I _{s max})	1500 mA
Maximum leakage current (I _{l max})	15 mA
Maximum switch resistance (Z _{c max})	150 m Ω

All wiring must conform to the current edition of IEE Wiring regulations and BS5839 Part 1

All loop Cable Screens shall be connected together, but must be Isolated from Ground. Cable Screens shall be connected to Earth Ground within the Control Panel ONLY.

Dimensions mm(in)

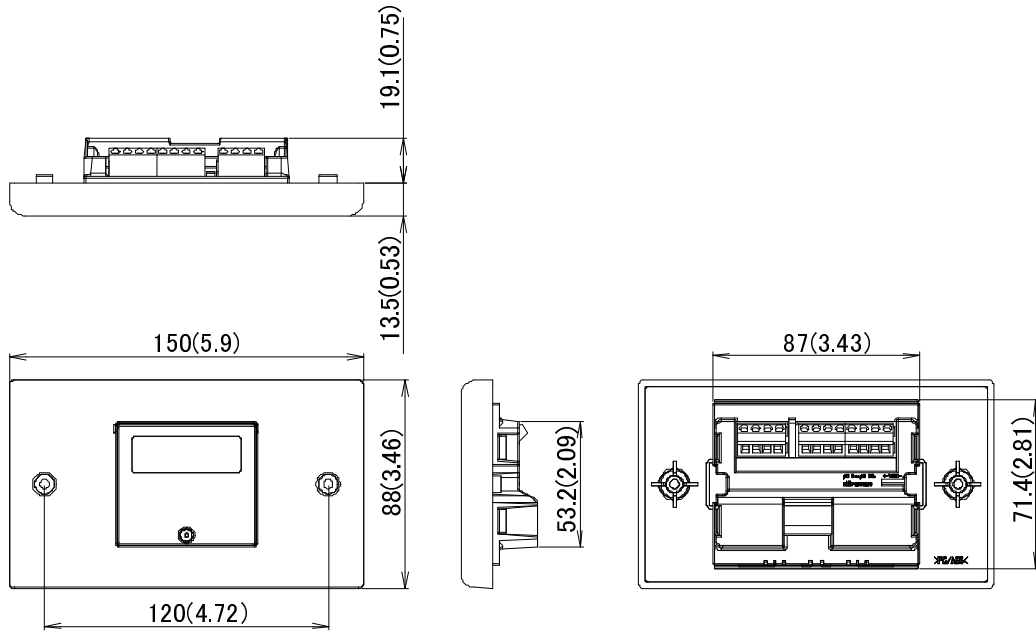

Connections

